



Technical Data (cont.)			
Device variant	Analog signal version	Fieldbus version	RS485 version (only D-Sub, 9 pin)
Analog communication Output signal (actual flow) Max. current voltage output Max. load current output	0 ... 5 V, 0 ... 10 V, 0 ... 20 mA or 4 ... 20 mA 10 mA 600 Ω	None	None
Fieldbus option (D-Sub HD15 covered with sealed plate for, pins for analogue inputs/outputs not connected)	None	PROFIBUS-DP, CANopen	Modbus RTU (via RS interface)
Digital communication via adapter possible:	RS232 (supports Modbus RTU) RS485, RS422 or USB		RS485, RS422 USB
Binary inputs (Default, other functions programmable)	Three: 1. not assigned 2. not assigned 3. not assigned		One: not assigned
Binary outputs (Default, other functions programmable)	Two relay outputs 1. Limit (Q_{nom} almost reached) 2. Error (e.g. sensor fault) Load capacity: max. 60 V, 1 A, 60 VA		One relay output 1. Limit (Q_{nom} almost reached) Load capacity: max. 25 V, 1 A, 25 VA

Pressure Loss Diagram (ref. to air, with 250µm inlet filter)

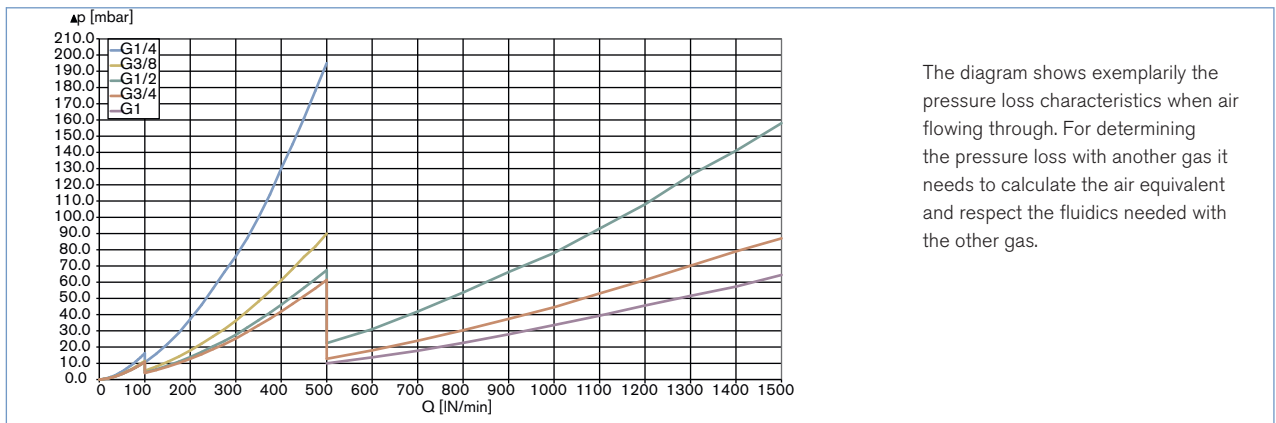

Measuring Principle

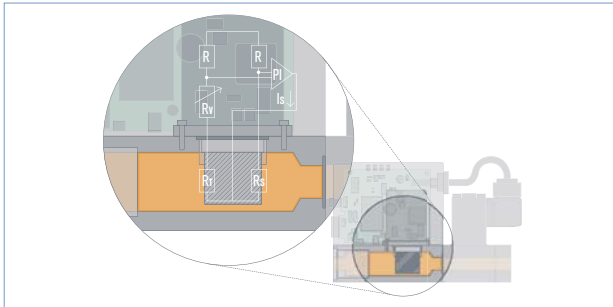

This sensor works as a hot-film anemometer in the so-called CTA operational mode (Constant Temperature Anemometer). To do this, two resistors with precisely specified temperature coefficients located directly in the media flow and three resistors located outside the flow are connected together to form a bridge.

The first resistor in the gas flow (R_1) measures the fluid temperature, while the second, low-value resistor (R_2) is heated so that it is maintained at a fixed, predefined over-temperature with respect to the fluid temperature.

Notes Regarding the Configuration

The decisive factors for the perfect functioning of an MFM within the application are the fluid compatibility, the max. inlet pressure and the correct choice of the flow meter range. The pressure drop over the MFM depends on the flow rate and the operating pressure.

► **The questionnaire on page 7 contains the relevant fluid specification. Please use in this way the experience of Burkert engineers already in the design phase and provide us with a copy of the questionnaire containing the data of your application together with your inquiry or order.**

Nominal Flow Ranges of Typical Gases

(Other gases on request)

Gas	Min. Q_{nom} [l _N /min]	Max. Q_{nom} [l _N /min]
Acetylene	20	975
Ammonia	20	1250
Argon	20	1500
Carbon dioxide	20	800
Air	20	2500
Methane	20	750
Propane	20	400
Oxygen	20	2500
Nitrogen	20	2500

The heating current required to maintain this is a measure of the heat being removed by the flowing gas, and represents the primary measurement.


An adequate flow conditioning within the MFM and the calibration with high-quality flow standards ensure that the mass of gas flowing per time unit can be derived from the primary signal with high accuracy.

Ordering Chart for Accessories

Article	Item no.	
Connectors / Cables		
Round plug M16 8 pin (Solder connection)	918 299	
Round plug M16 8 pin with 5 m cable	787 733	
Round plug M16 8 pin with 10 m cable	787 734	
Plug D-Sub HD15 15 pin with 5 m cable	787 735	
Plug D-Sub HD15 15 pin with 10 m cable	787 736	
Adapters⁴⁾		
RS232 adapter for connection to a computer, connection with an extension cable (Item no. 917 039)	654 757	
Extension cable for RS232 9 pin socket/plug 2 m	917 039	
RS422-Adapter (RS485 compatible)	666 370	
USB-Adapter (Version 1.1, USB socket type B)	670 696	
USB connection cable 2 m	772 299	
Adapter for manual bus adresse settings (instad of SW)	667 525	
Software MassFlowCommunicator	Download from www.buerkert.com	
Accessories for Fieldbus	PROFIBUS DP (B-coded)	CANopen (A-coded)
M12-Plug ⁵⁾	918 198	917 115
M12-socket ⁵⁾	918 447	917 116
Y-junction ⁵⁾	902 098	788 643
T-junction	918 531	(on request)
Terminating resistor	902 553	(on request)
GSD-File (PROFIBUS), EDS-File (CANopen)	Download from www.buerkert.com	


⁴⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.

⁵⁾ The two M12 connectors as listed above cannot be used together on the same side of the Y-junction. At least one of the two M12 connection needs to be an overmoulded cable which uses typically a thinner connector.

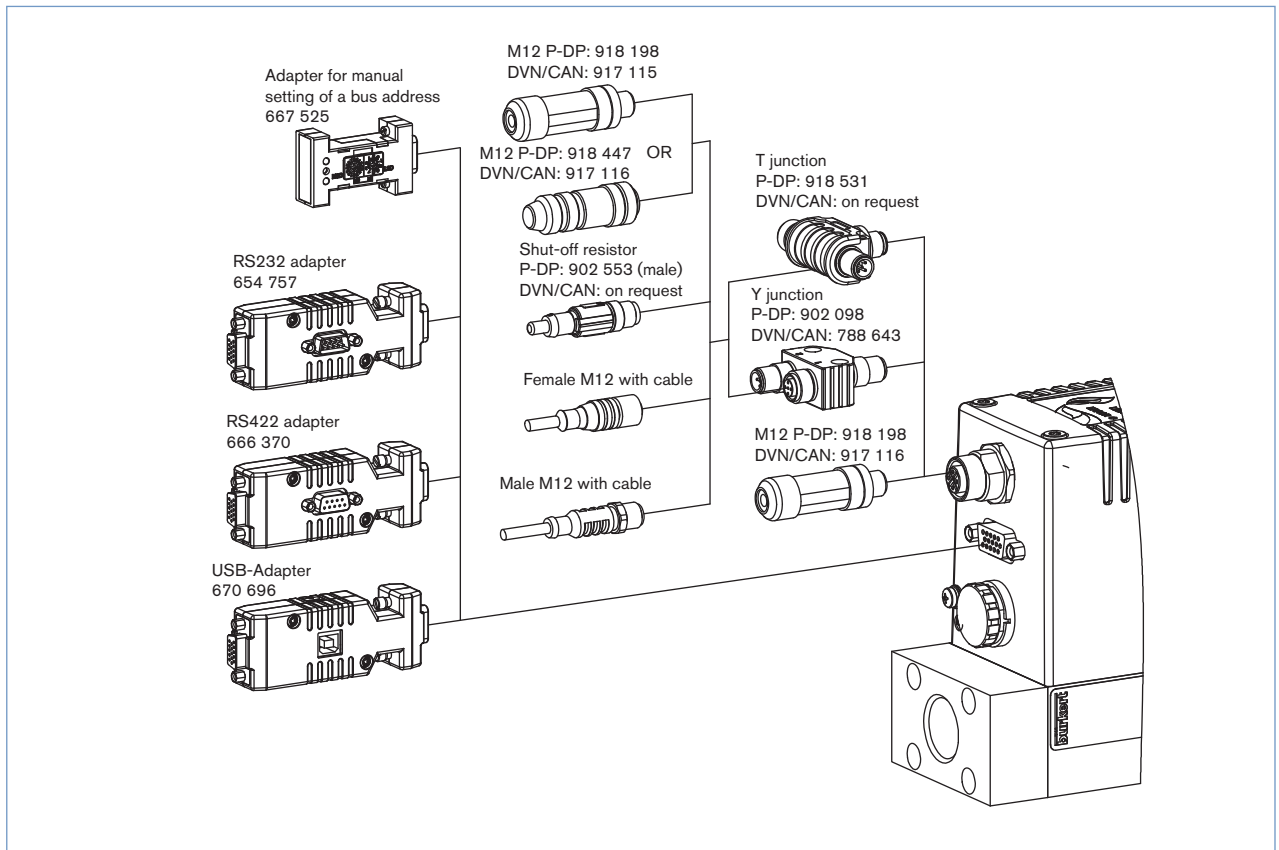


Pin Assignment

DTS 1000017532 EN Version: L Status: RL (released | freigegeben | valide) printed: 18.10.2017

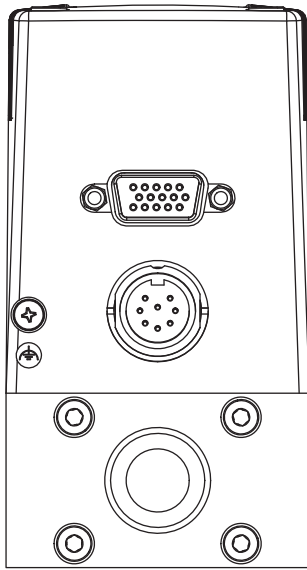


Standard

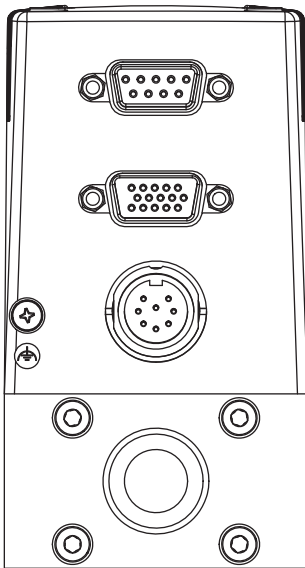

Fieldbus D-SUB

Socket D-Sub HD15

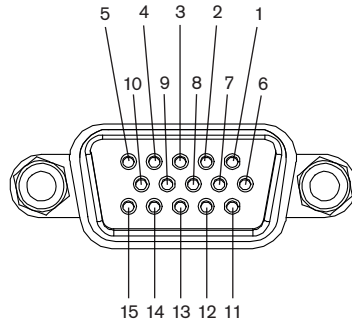


Pin	Assignment	
	Analog Version	Bus Version
1	N.C. [®]	N.C.
2	N.C.	N.C.
3	Actual value output +	N.C.
4	Binary input 2	
5	12 V-Output (only for factory use)	
6	RS232 TxD (direct connection to computer)	
7	Binary input 1	
8	GND (for binary inputs)	
9	only for factory use (do not connect!)	
10	12 V-Output (only for factory use)	
11	12 V-Output (only for factory use)	
12	Binary input 3	
13	Actual value output GND	N.C.
14	RS232 RxD (direct connection to computer)	
15	DGND (for RS232-interface)	

[®]N.C.: not connected (not used)

Note:

- Optional Pin 1 and 2 with bus version as transmitter input possible
- The cable length for RS232/ Setpoint and flow value signal is limited to 30 meters.


Socket M16, round, 8 pin

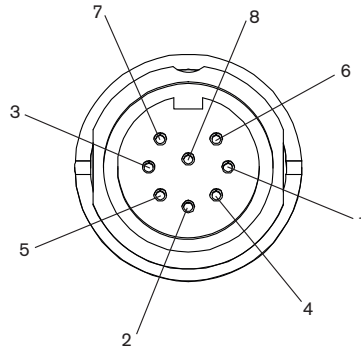

Pin	Assignment
1	24 V-Supply +
2	Relay 1 – reference contact
3	Relay 2 – reference contact
4	Relay 1 – Normally closed contact
5	Relay 1 – Normally open contact
6	24 V-Supply GND
7	Relay 2 – Normally open contact
8	Relay 2 – Normally closed contact


Socket D-Sub 9 pin

(only with fieldbus version)

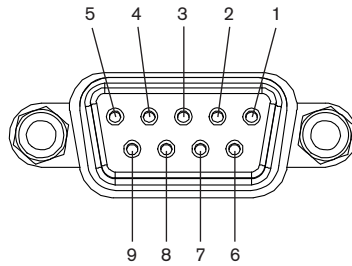


Pin	Assignment	
	PROFIBUS DP	CANopen
1	Shield	Shield
2	N.C.	CAN-L data line
3	RxD/TxD - P (B-line)	GND
4	RTS (control signal for repeater)	N.C.
5	GND	N.C.
6	VDD (only for termination resistor)	N.C.
7	N.C.	CAN-H data line
8	RxD/TxD - N (A-line)	N.C.
9	N.C.	N.C.


Pin Assignment (continued)

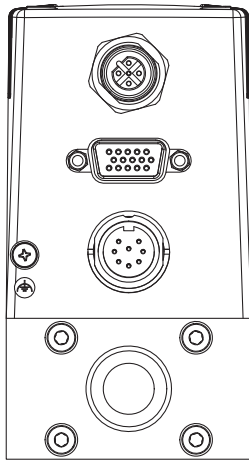

M12 Profibus

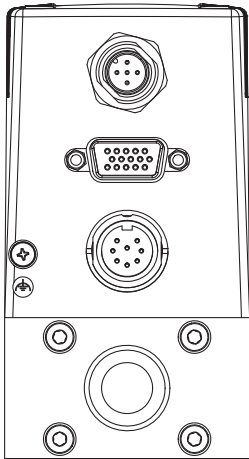


M12

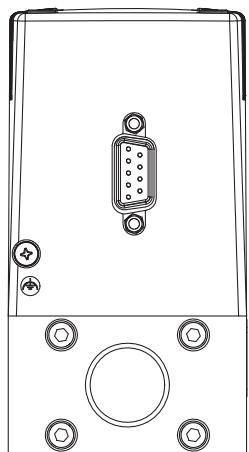


RS485 version

PROFIBUS DP – socket B-coded M12 (DPV1 max. 12 Mbaud)

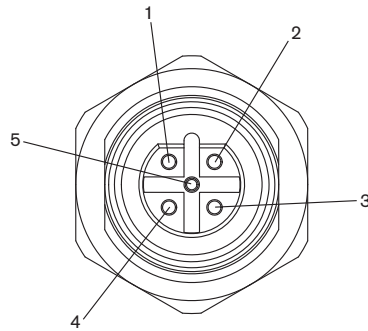

Pin	Assignment
1	VDD (only for termination resistor)
2	RxD/TxD – N (A-line)
3	DGND
4	RxD/TxD – P (B-line)
5	N.C.


CANopen – Plug A-coded M12

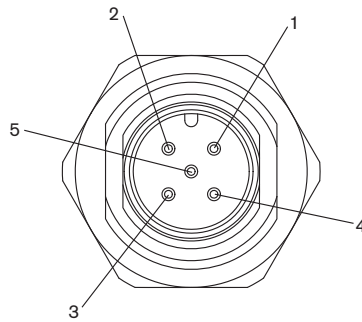

Pin	Assignment
1	Shield
2	N.C. ⁷⁾
3	DGND
4	CAN_H
5	CAN_L



⁷⁾ Optional configuration with 24 V DC possible for power supply via fieldbus connector. With this no power supply connection on round M16 plug needed.

Plug D-Sub 9 pin

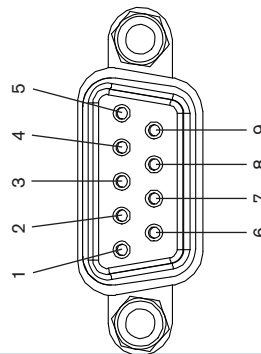

Pin	Assignment
1	Binary input (related to GND Pin 2)
2	GND
3	Power supply + 24 V DC
4	Relay, normally opened
5	Relay, normally closed
6	TX+ (RS485-Y) – bridge with pin 9 at half duplex
7	TX- (RS485-Z) – bridge with pin 8 at half duplex
8	RX- (RS485-B)
9	RX+ (RS485-A)

Dimensions [mm]

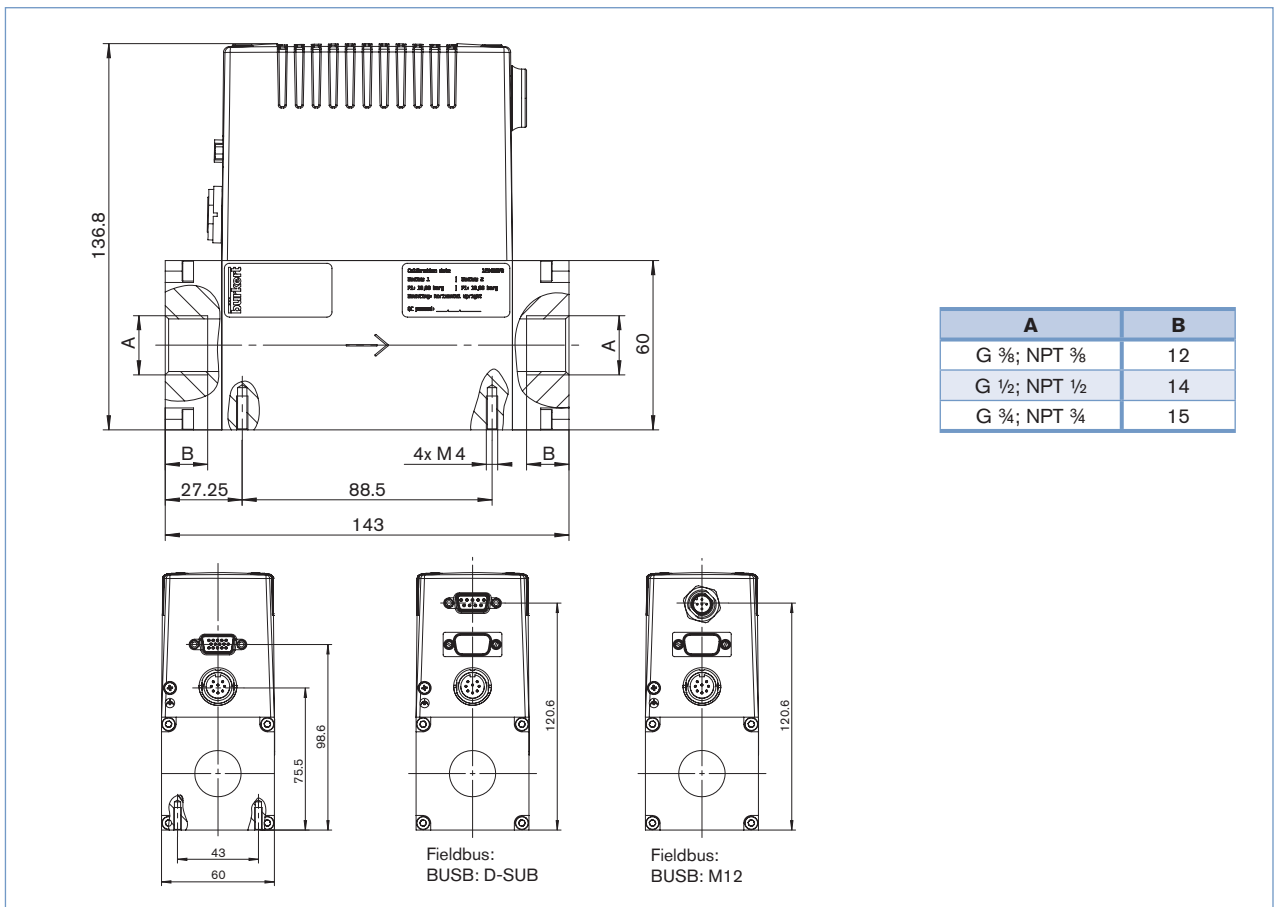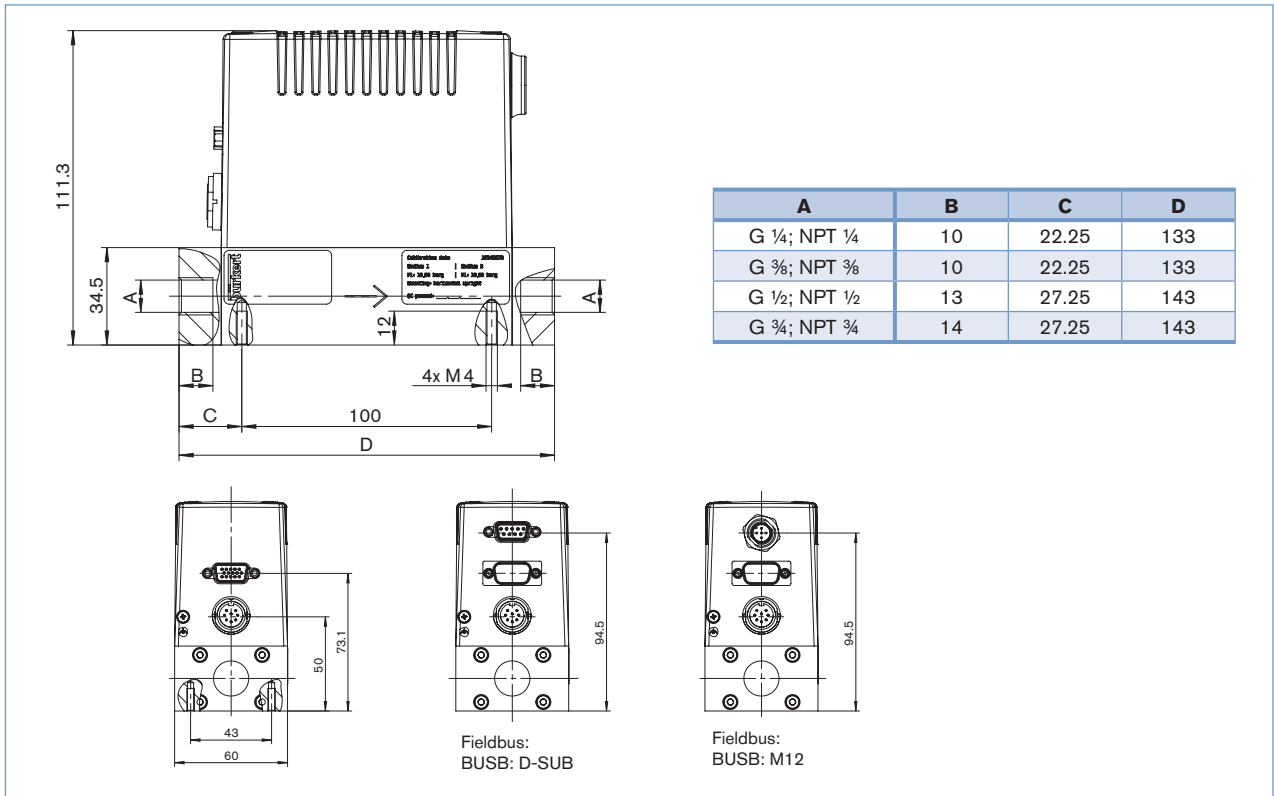

MFC/MFM Applications – Request for Quotation

▶ Please complete and send to your nearest Bürkert sales centre

Company	Contact person
Customer No	Department
Address	Tel./Fax
Postcode/Town	E-mail

 MFC-Application MFM-Application Quantity Required delivery date

Fluid data

Type of gas (or gas proportion in mixtures)

Density kg/m³⁸⁾

Gas temperature °C °F

Moisture content g/m³

Abrasive components/solid particles no yes, as follows:

Fluidic data

Flow range Q_{nom} Min. l_N/min⁸⁾ l_S/min (slpm)⁹⁾
 Max. m_N³/h⁸⁾ kg/h
 cm_N³/min⁸⁾ cm_S³/min (scm)⁹⁾
 l_N/h⁸⁾ l_S/h⁹⁾

Inlet pressure at Q_{nom} ¹⁰⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure $p_{1 max}$ bar(g) ■

MFC/MFM port connection without screw-in fitting
 1/4" G-thread (DIN ISO 228/1) 1/4" NPT-thread (ANSI B1.2)
 3/8" G-thread (DIN ISO 228/1) 3/8" NPT-thread (ANSI B1.2)
 1/2" G-thread (DIN ISO 228/1) 1/2" NPT-thread (ANSI B1.2)
 3/4" G-thread (DIN ISO 228/1) 3/4" NPT-thread (ANSI B1.2)
 with screw-in fitting
 mm Pipeline (external Ø)
 inch Pipeline (external Ø)

Installation horizontal, valve upright (standard) horizontal, valve on side
 vertical, flow upwards vertical, flow downwards

Ambient temperature °C

Material data

Body (base block) Aluminium (anodised) Stainless steel

Seal material FKM EPDM

Electrical data

Signals for set point and actual value	Standard signal Setpoint / Actual value	with fieldbus	with RS485
	<input type="checkbox"/> 0 ... 5 V <input type="checkbox"/> 0 ... 20 mA	<input type="checkbox"/> PROFIBUS DP <input type="checkbox"/> M12	<input type="checkbox"/> D-Sub
	<input type="checkbox"/> 0 ... 10 V <input type="checkbox"/> 4 ... 20 mA	<input type="checkbox"/> CANopen <input type="checkbox"/> D-Sub	

■ Please quote all pressure values as overpressures with respect to atmospheric pressure [bar(ü)]

8) at: 1.013 bar(a) and 0 °C

9) at: 1.013 bar (a) and 20 °C

10) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box

www.buerkert.comIn case of special application conditions,
please consult for advice.Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1710/8_EU-en_00891901